

# Automation Project Execution Procedure

## DOCUMENT HIERARCHY

This document resides within the Planning component of Western Power's Asset Management System (AMS).

## DOCUMENT DATE

This document was last updated May 2026

## IMPLEMENTATION DATE

This document came into service October 2017

## DOCUMENT CONTROL

Record of endorsement, approval, stakeholders, and notification list is provided in ID-005-c024441ff65d938e13b93445d9836102 appendix

## RESPONSIBILITIES

Western Power's Engineering & Design Function is responsible for this document

## CONTACT

Western Power welcomes your comments, questions, and feedback on this document, which can be emailed to [standards.excellence@westernpower.com.au](mailto:standards.excellence@westernpower.com.au)

## DISCLAIMER

This document is published by Western Power for information purposes only. The user must make and rely on their own inquiries as to the quality, currency, accuracy, completeness, and fitness for purpose of any information contained in this document. Western Power does not give any warranty or make any representation concerning the information provided in this document. By using the information in this document, the user acknowledges that they are solely responsible for obtaining independent professional advice prior to commencing any project, activities, or other works. Western Power is not liable in any way for any loss, damage, liability, cost or claim of any kind whatsoever (including responsibility by reason of its negligence) arising from or in connection with the use of or reliance on the information contained in this document. Western Power reserves its rights to modify, supplement or cancel this document or any part thereof at any time and without notice to users.

## COPYRIGHT

© Copyright 2026 Electricity Networks Corporation trading as Western Power. All rights reserved. No part of this work may be reproduced or copied in any form or by any means without the written permission of Western Power or unless permitted under the Copyright Act 1968 (Cth). Product or company names are trademarks or registered trademarks of their respective holders

© Western Power  
ABN 18540492861



# Contents

Revision Details .....	3
1. Introduction .....	4
1.1 Purpose and scope .....	4
1.1.1 Project Checkpoints .....	4
1.2 Definitions .....	5
1.3 References .....	6
2. Design .....	6
2.1 Preliminary Design .....	6
2.2 Final Design .....	6
3. Materials Management .....	7
4. Construction.....	7
5. Configuration .....	7
5.1 Preliminary Configuration works .....	7
5.2 Final Configuration Works .....	7
6. Commissioning.....	8
6.1 Commissioning Planning .....	8
6.2 Site Commissioning .....	8
7. Project Finalisation .....	8
8. Project Handover.....	8
Appendix A – Key Automation Project Documents .....	9
Appendix B – Automation Projects Procedure – Internal Delivery .....	10
Appendix C – Automation Projects Procedure – External Delivery .....	11
Appendix D – Project Checkpoints .....	12
Appendix E – USA Project Checklist and Guide .....	13
Appendix F – AUTOMATION DESIGN - eNAR APPLICATION PROCESS.....	16
Appendix G - Approval Record and Document Control .....	17

## Revision Details

Version	Date	Summary of change	Section
0	Oct-2017	Initial release	
1	May-2020	Expanded to Cover Project Execution	
2	April-2022	Added Project Guide and Checklist	
3	May-2023	Refresh document to current practices and references	
4	08/09/2023	Updated formatting and added Project Checkpoints	Appendix D
5	28/03/2024	Updated copyright information. Added reference to Customer Interface Guideline in section 5 and Customer Interface List in Appendix G. Updated Commissioning deliverable text in Appendix D.	All sections
6	20/3/2026	Updated Appendix D terminology and introduction	

## 1. Introduction

### 1.1 Purpose and scope

The purpose of this document is to provide an overview of the process for the execution of projects within the Automation team. This document is intended a guide for personnel working on the delivery of automation projects and covers the following activities for project delivery.

- a) Design
- b) Materials
- c) Construction
- d) Configuration
- e) Commissioning
- f) Project Finalization

Refer to Appendix A<sup>1</sup> for the document structure providing an overview of the key documents for Automation project delivery.

Refer to Appendix B & C for the typical Project Execution Process.

#### 1.1.1 Project Checkpoints

Refer to Appendix D for the key project checkpoints. These checkpoints provide an opportunity to evaluate the quality and completeness of each stage before progressing to the subsequent phase.

---

<sup>1</sup> Internal Western Power documentation is available to accredited vendors.

## 1.2 Definitions

Terms and definitions used in this document:

<b>Term</b>	<b>Definition</b>
AMS	Asset Management System
AP A&C	Asset Performance – Automation and Control Team
E&D	Engineering and Design – Operational Technology
eNAR	Electronic Network Access Request
FPT	Field Protection and Telecommunications
NMPD	Network Maintenance Planning and Delivery
NO	Network Operations
PEA	Project Erection Authority
RACI	Responsibility Matrix
SCADA	Supervisory Control and Data Acquisition
USA	Upgrade Substation Automation

## 1.3 References

Refer to Appendix G<sup>2</sup> for internal references.

## 2. Design

All Automation Designs shall be completed in accordance with Automation Design Guideline<sup>2</sup> and templates. Where a connection is required to a customer refer to the Automation Design Customer Interface Guideline<sup>2</sup>. The design process can be split into two stages detailed as follows.

### 2.1 Preliminary Design

During preliminary design main interfaces to the automation system and functional requirements should be determined. At this stage design inputs from other design teams are reviewed and high-level design is developed. Any Automation System requirements should be agreed with the other teams and customers at this stage.

Preliminary Design includes the following activities:

- a) Determine Scope of Works
- b) Review Automation System
- c) Develop Preliminary Design including:
  - i. Equipment Requirements
  - ii. Interface Requirements
  - iii. Power Supply Requirements
  - iv. Cubicle layouts
  - v. Building and Site layouts
  - vi. Works schedule considerations
  - vii. Safety in Design Considerations
- d) Determine high level construction scope for resource planning

### 2.2 Final Design

The Automation Design can be completed in parallel with the secondary design. The Final Automation Design should include the following

- a) All drawing completed
- b) Installation construction PEA completed including any staging requirements
- c) Asset List completed (without serial numbers)
- d) Planned Changes notification to Maintenance

When the final design is completed the required project dates should be known to ensure the Installation scope of works reflects required works dates.

---

<sup>2</sup> Internal Western Power documentation is available to accredited vendors.

### 3. Materials Management

Automation Design are responsible for the specification, procurement, and handover of automation field equipment. Materials management activities are detailed in Automation Design Guidelines Materials Management section<sup>3</sup>.

Materials management includes the following activities:

- a) Materials Specification
- b) Standard Materials Introduction
- c) Procurement and Material Handling
- d) Asset Recording

### 4. Construction

Construction Works involve the physical installation of materials and equipment. Construction activities shall be completed in accordance with Automation Design Guidelines Construction section<sup>3</sup>.

Construction Activities is as follows:

- a) Resource allocation
- b) Issue of scope and Construction Planning
- c) Panel Construction
- d) Field Construction
- e) Construction finalisation

### 5. Configuration

Configuration activities shall be completed in accordance with Automation Design Guidelines Configuration section<sup>3</sup>. This includes using equipment templates and equipment specific work instructions to complete the configuration files.

The configuration process can be split into two stages detailed as follows.

#### 5.1 Preliminary Configuration works

Preliminary configurations works are the works required to be completed to plan and schedule head end changes and outages and to determine functional and operations requirements for any schemes to be implemented.

The preliminary site configuration works for Automation Include the following activities:

- a) Configuration Requirements Development
- b) Determination of functional and operational scheme requirements
- c) For customer connections agreed interface point list is developed as per the Customer Interface template<sup>3</sup>.
- d) Preparation of Commissioning Sheets and Plans
- e) Head End Changes specification

#### 5.2 Final Configuration Works

The preliminary site configuration works for Automation Include the following activities:

- a) Preparation of Configuration
- b) Pre-Commission checks of IEC61850 MMS settings
- c) FAT bench testing for special schemes and new customer connections
- d) Update of site Documentation including Scheme Work Instructions
- e) Head End Configuration works

---

<sup>3</sup> Internal Western Power documentation is available to accredited vendors.

## 6. Commissioning

Commissioning activities shall be completed in accordance with Automation Design Guideline Commissioning section<sup>4</sup>.

The commissioning process can be split into two stages detailed as follows.

### 6.1 Commissioning Planning

Commissioning Planning involves the following activities;

- a) Commissioning planning and coordination of works with other Commissioning Teams
- b) Commissioning resource Allocation
- c) Outage Notification and Approval as per Automation Design eNAR Application Process
- d) Preliminary Handover to Maintenance

### 6.2 Site Commissioning

Site commissioning involves the following activities

- a) Finalisation of Automation Installation works
- b) Coordination of Master Station Updates
- c) Commissioning of Automation Equipment (including completed commission sheets, logging and remote management)
- d) Commissioning of Telecommunication Channels
- e) Commissioning of Automation settings files
- f) In service Notification to Maintenance
- g) Site Records Updates (includes Asset Register, Notes file, Red line markups, Configuration Backups and PLC Work instruction)
- h) Site Photo Updates

## 7. Project Finalisation

Project finalisation involves updating design and config information and site records following commissioning. This includes the following works, these activities are detailed in the relevant guidelines.

- a) Design and Documentation updates
- b) Finalising site asset information
- c) Commissioning Sheet Finalisation
- d) Maintenance Handover
- e) Cancel Obsolete Services

## 8. Project Handover

A staged handover to SCADA Field Maintenance is required as part of the Project execution. Refer to the Automation Quality Assurance process and Handover Guideline<sup>4</sup>.

---


<sup>4</sup> Internal Western Power documentation is available to accredited vendors.

Left intentionally blank


---

<sup>5</sup> Internal Western Power documentation is available to accredited vendors.

## Appendix B – Automation Projects Procedure – Internal Delivery

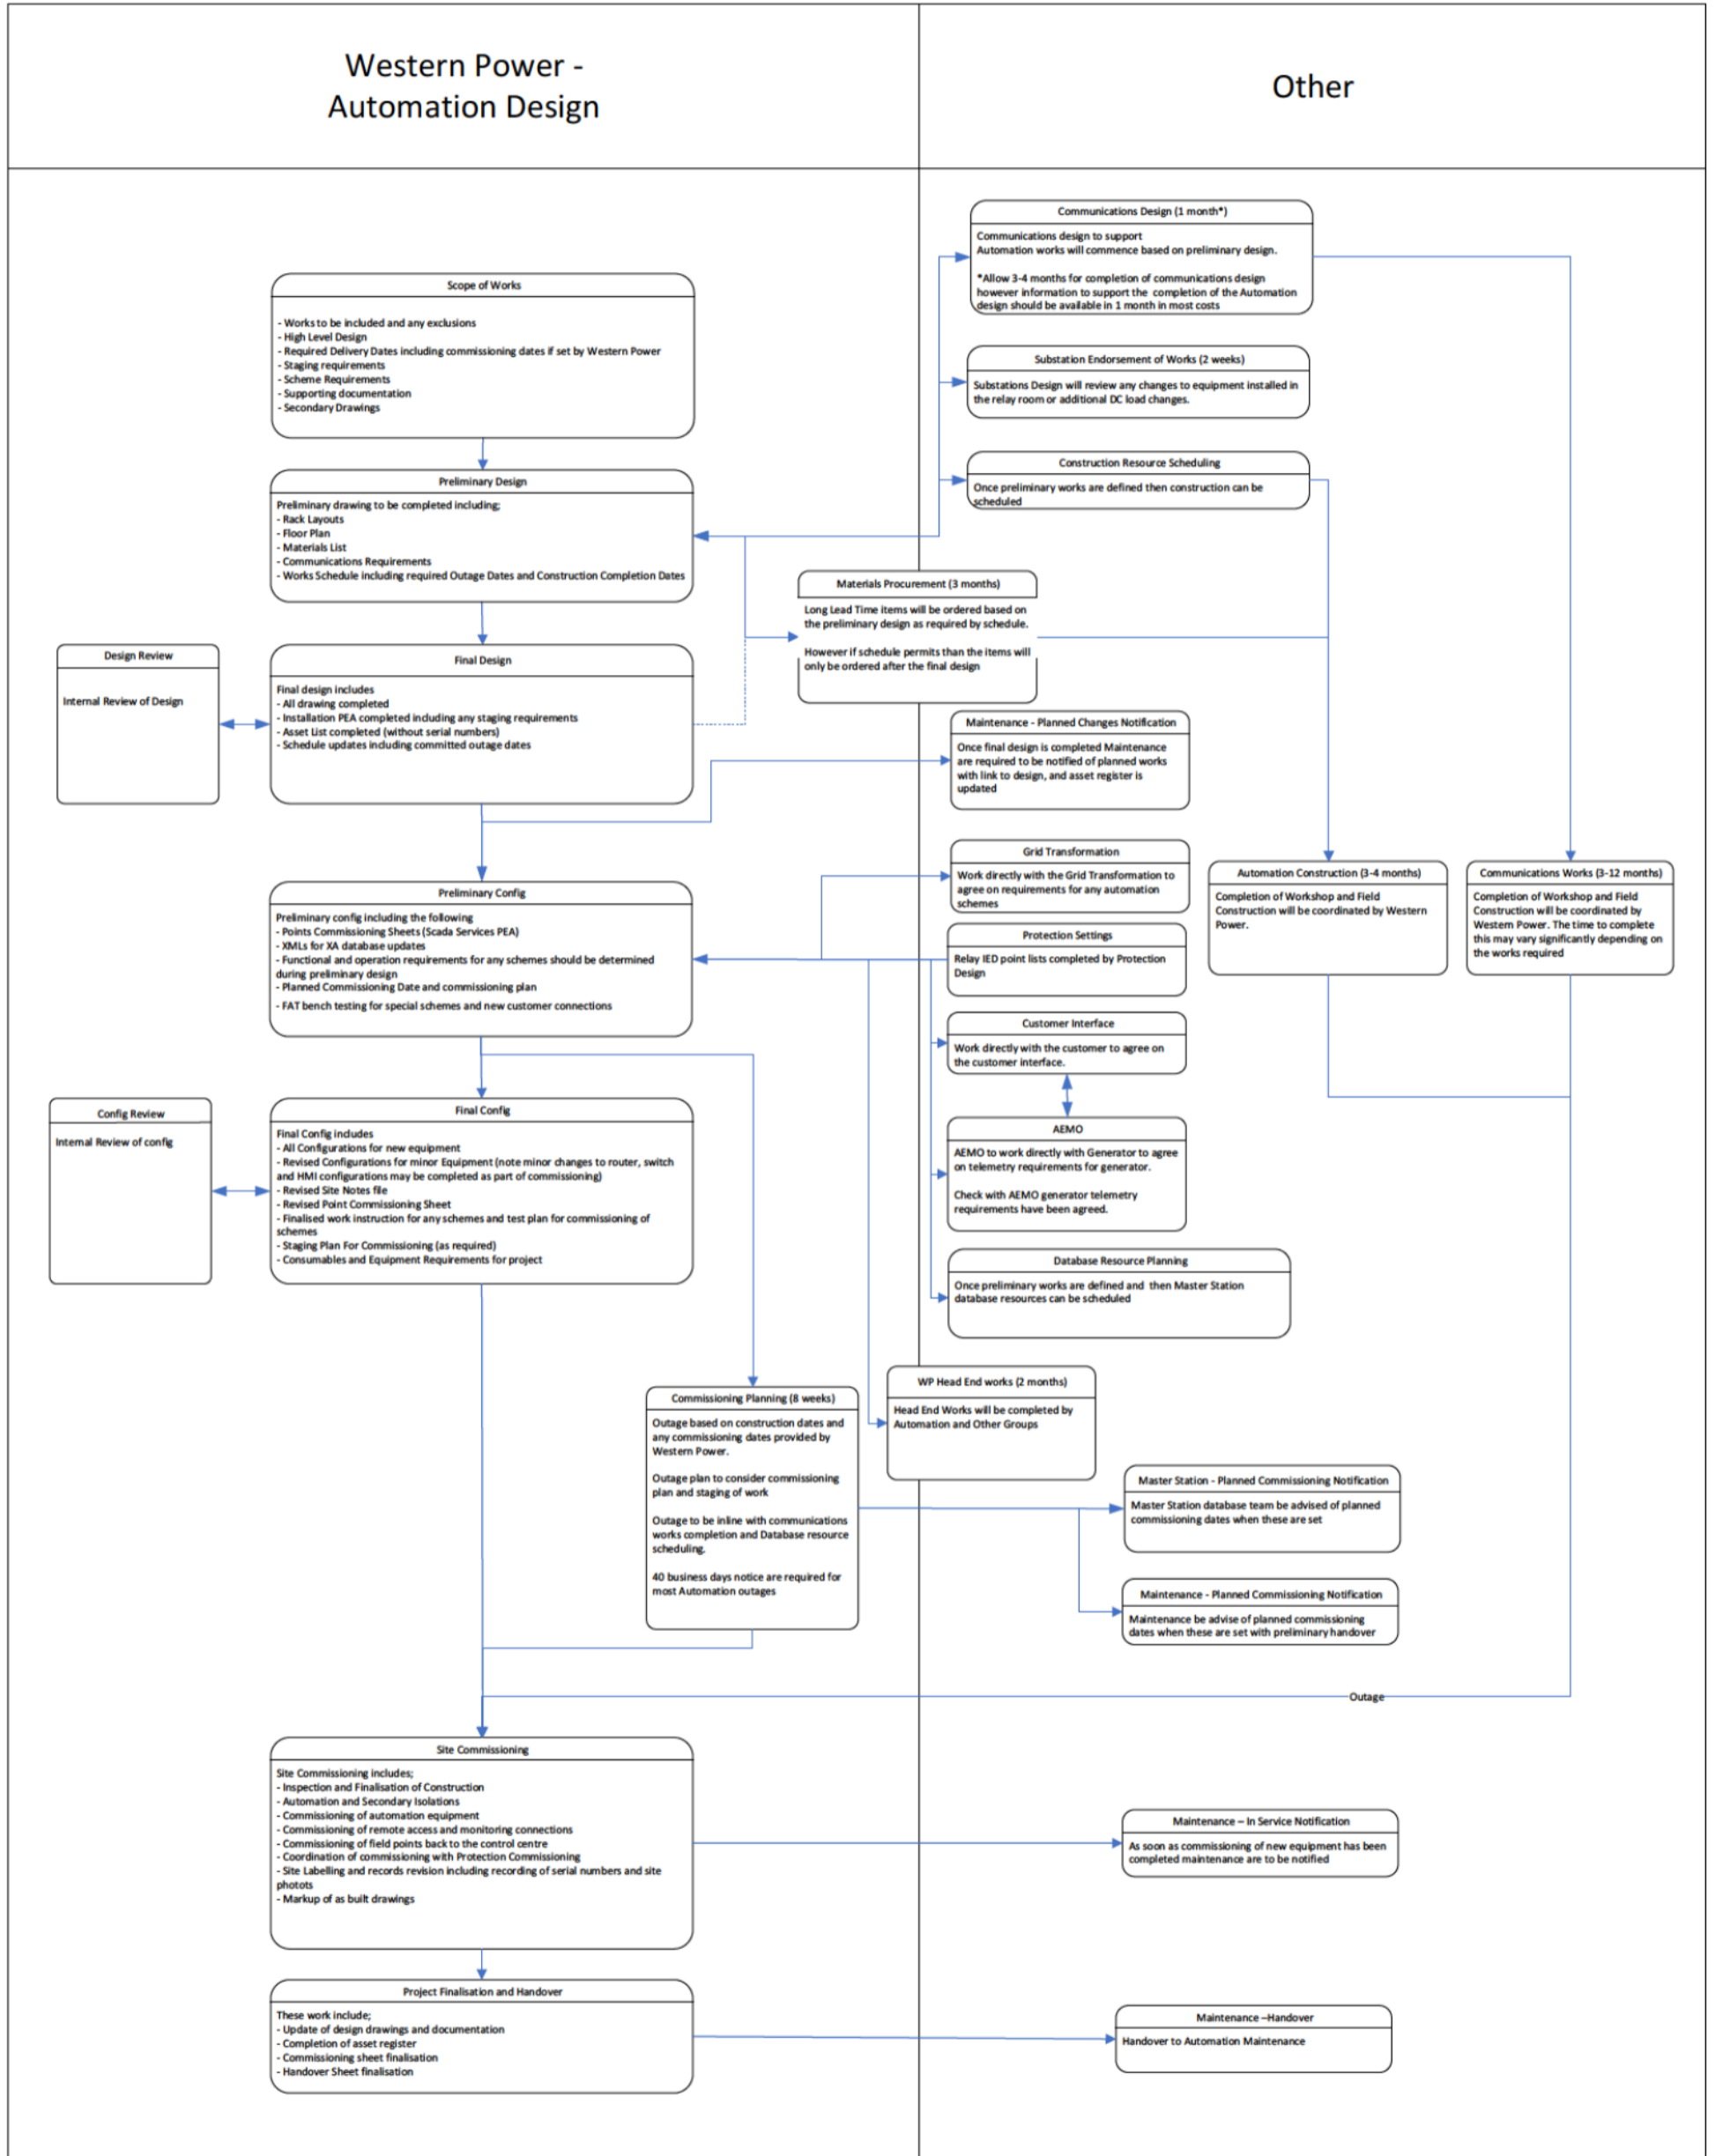

Appendix C – Automation Projects Procedure – External Delivery

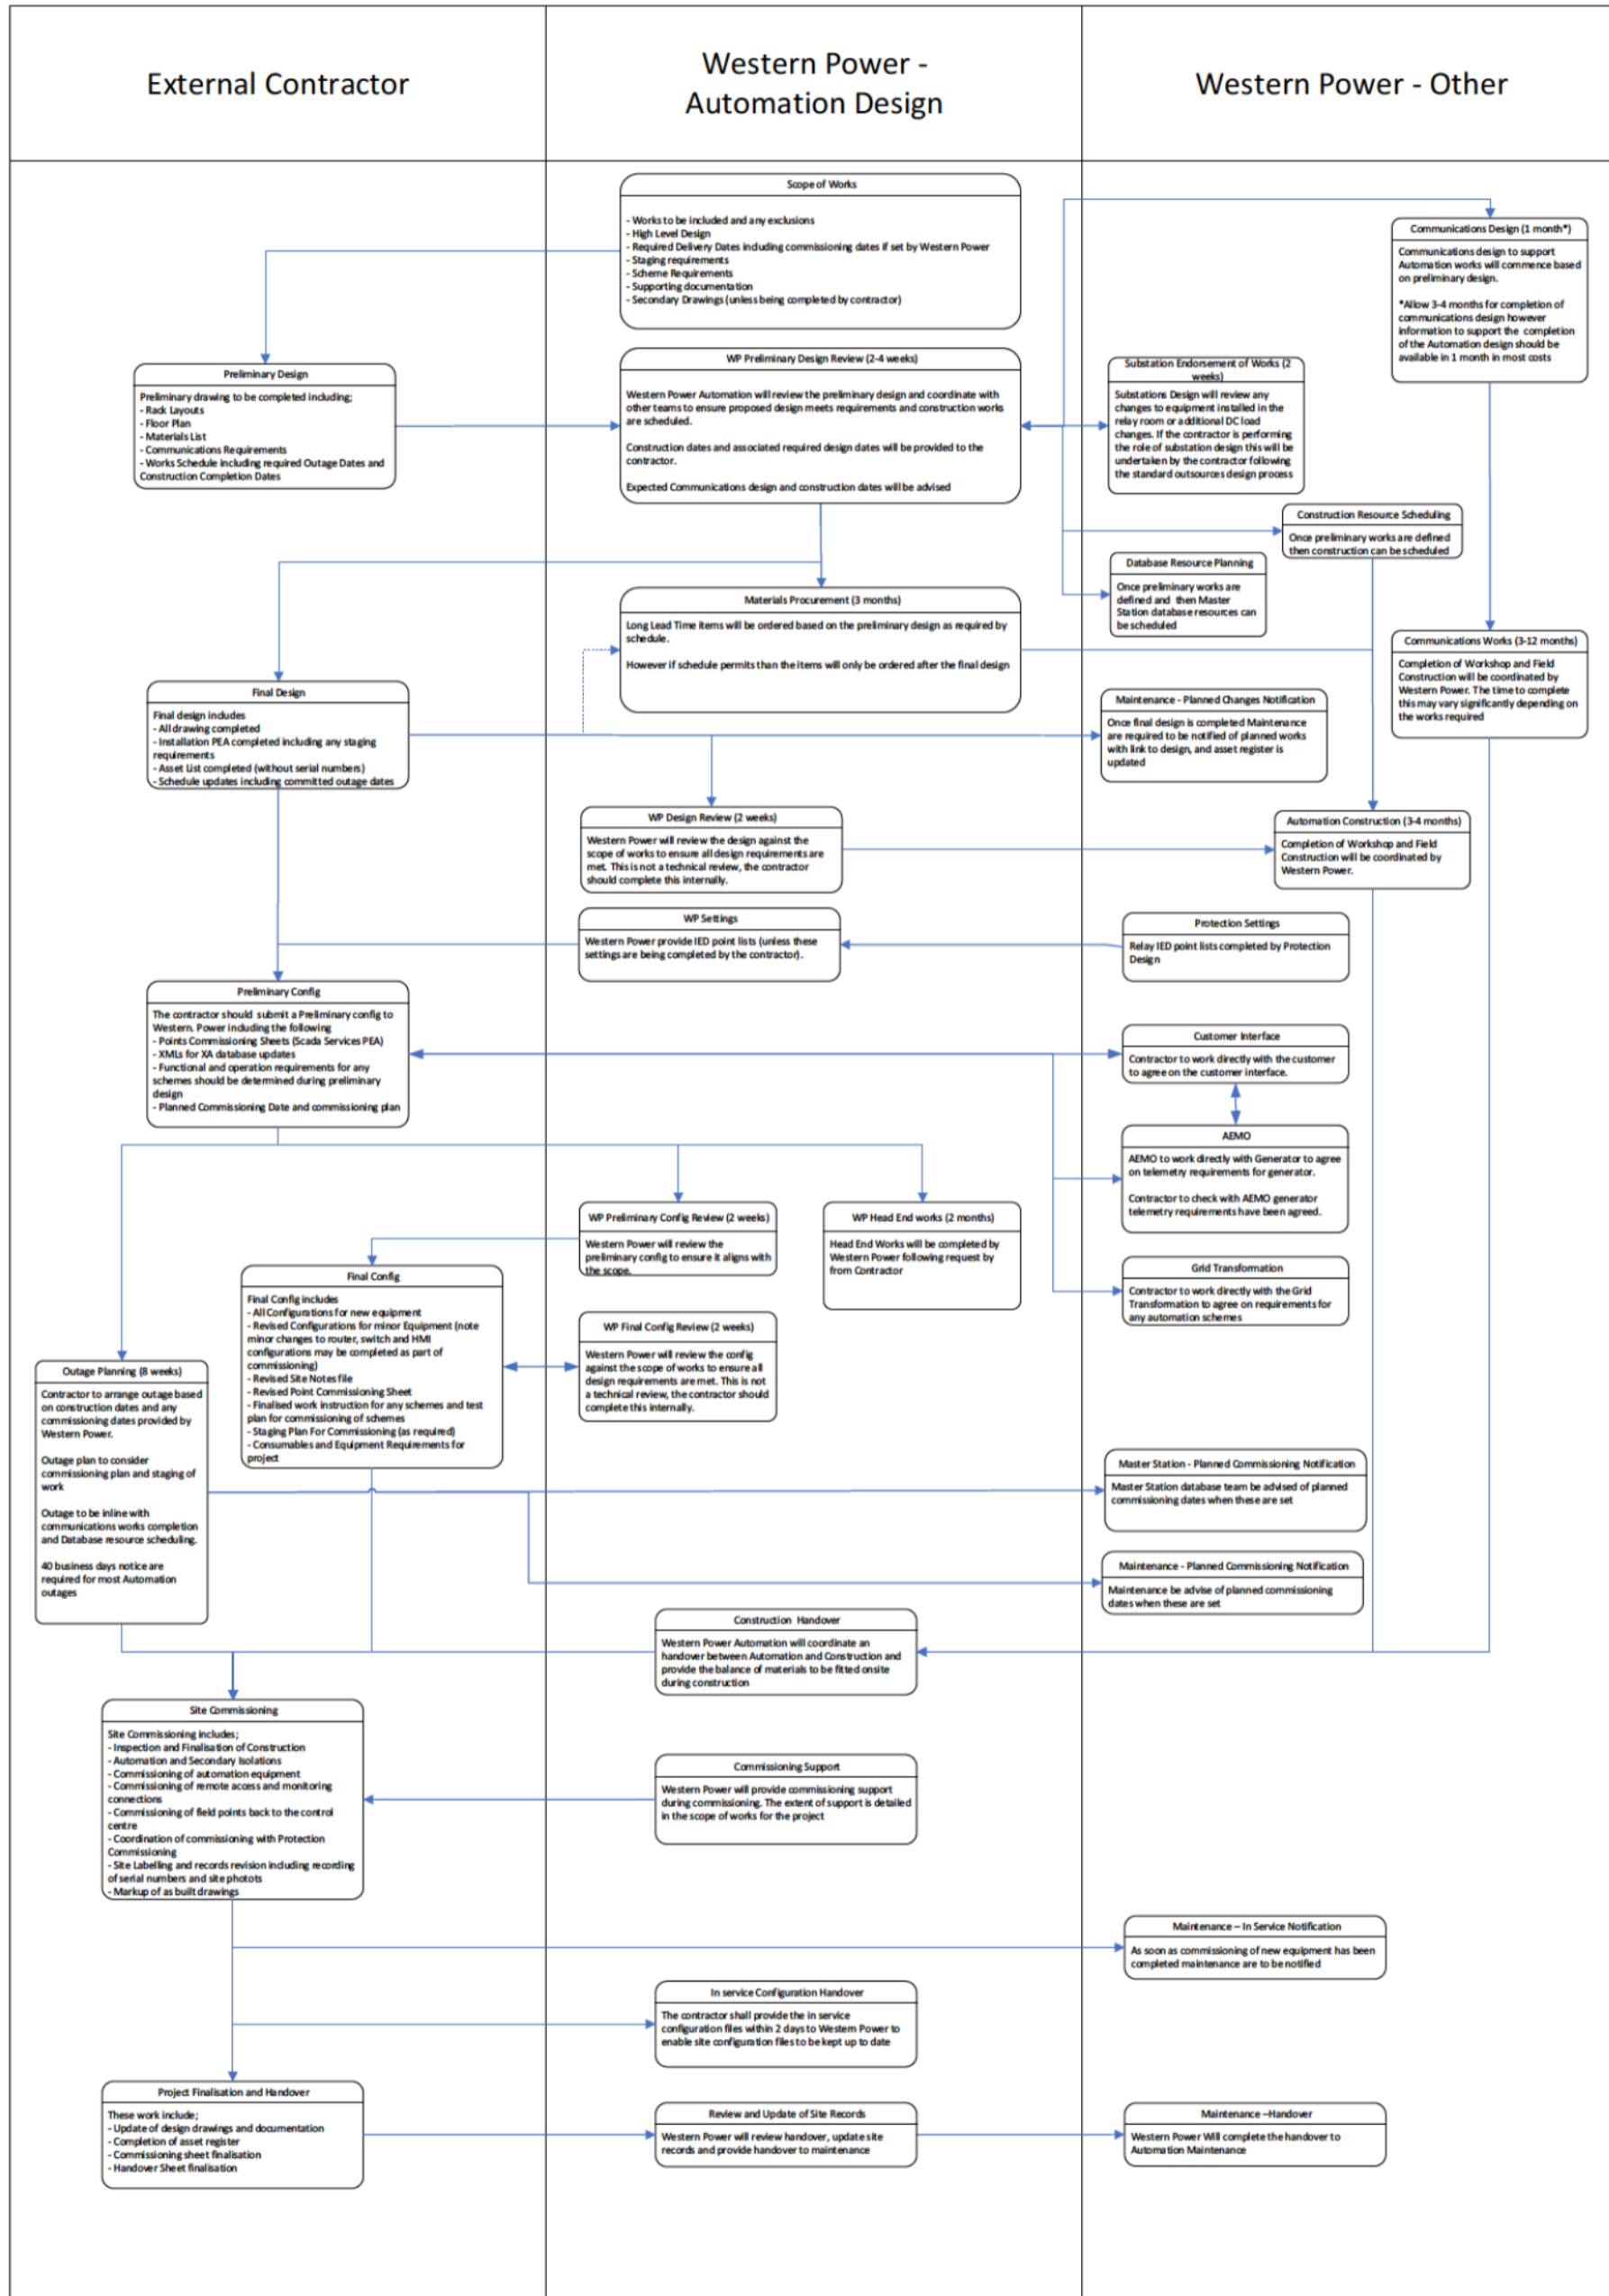

## Appendix D – Project Checkpoints

Discipline	Deliverables
Project	WIR, DDA for Drawings
	Project Schedule
	Safety in Design - Hazard Spreadsheet
	Request for Information (RFI) register
Design	Automation Drawings
	Construction Services PEA
	Site Visit
	Bill Of Materials (BOM)
Config	SCADA Services Commissioning Sheet, ICT Request for Firewall patching and eNAR.
	Equipment Configurations
	Site Work Instruction
	Point Control
	Scheme Work Instructions
	Preliminary Handover
Materials	Ordering Materials
	Have the materials been ordered?
Commissioning	Construction
	Completed Isolation Schedules
	Commissioning of All Equipment of Points
	Site Photographs
	Completed Equipment Sheets
	Site USB Revised – Notes file and equipment setting backups
	Commissioned configurations Backed Up to management systems
Project Finalisation	Revise Asset Register with Serial Numbers for all installed hardware
	As-Built Drawings
	Removal and return of redundant hardware
	Cancellation of unused Communications Services

## Appendix E – USA Project Checklist and Guide

Stage	Task	Overview	References
Design	1. Review Site Drawings and Configuration	<p>Check Drawings for site to see what Automation Equipment is on site, and how equipment has been installed.</p> <p>Review configuration to see what the interfaces are on the equipment and what logic is implemented.</p> <p>New design should be implemented based on design guide.</p>	Automation Design - USA Design Guide
	2. Obtain External Inputs	Discuss with telecommunications any proposed changes to circuits and with substations any proposed changes to station DC connections or new cubicles being installed	
	3. Determine Staging	Based on high level design develop high level plan for staging of implementation. Where possible the site needs to be returned completely to service at the end of every day. Where complex schemes exist, it may not be possible to put scheme into service until all inputs are cutover, in these cases an extended outage may be required for the scheme. Contact network operations engineering to discuss any extended outages that may be required	
	4. Complete Markups	<p>Markup drawings based on templates and complete drafting request to have drafting completed.</p> <p>At this stage long lead time equipment is identified and orders can be placed.</p> <p>If construction works are minor (&lt;15 hours effort, simple indoor cable runs and retrofit of existing cubicle) these can be completed by Automation as part of commissioning. Otherwise, it is recommended construction complete these works. An installation PEA is required to be completed. Confirm with the project manager if construction works are internal or external, this will determine who drawings are issued to.</p>	Automation Design - Register - Template Drawings
	5. Drafting Completed	Request drafting to be completed by handing markups to drafting team. When drawings are issued you will review and electronically sign.	
	6. Complete Installation PEA	<p>Complete installation PEA clearly identifying which work are to be completed by construction and what works will be completed by automation as part of the cutover.</p> <p>Once PEA is issued confirm through PM when works are scheduled to be completed and ensure any materials required will be available in time.</p>	Automation - Template - Installation Scope of Works
Materials	7. Order long lead time equipment	<p>Ideally long lead time equipment is ordered by construction. However, if there is not sufficient time from issue of drawings to planned construction date then these should be ordered as early as possible once equipment requirements are firm.</p> <p>Most long lead time equipment is stock coded order these using a purchase requisition other equipment can be ordered with a purchase order or a credit card</p> <p>Note for USA some equipment has been ordered in advance check the order register in the project workbook before ordering equipment</p>	Automation Design Guideline Materials section
	8. Order other equipment	<p>Other equipment and consumables such as terminals, cable, patch leads, MCBs, boot laces, surge arrestors and should be ordered via purchase order and credit card</p> <p>Note etched labels can be ordered from Kewdale Depot to allow fixture on site by Automation</p>	
Construction	9. Construction	<p>Construction will schedule the cubicle builds and field construction based the request from the PM, ensure this has been arranged by the PM.</p> <p>Any equipment which has been ordered by Automation and needs to be installed into the rack needs to be delivered to Kewdale Depot to allow construction to be completed</p> <p>The field construction schedule can be referred to see who is completing construction and when it is scheduled. Construction do not always provide feedback on when works are completed and should be contacted to ensure works are on track or completed.</p>	
Config	10. Extract Existing RTU Configuration	The existing D20/200 configuration will need to be migrated to the new gateway. The OCA toolset can be used to create the new configuration.	Automation - OCA - Point Config Tool

Stage	Task	Overview	References
	11. Review requirements for Schemes	If any schemes are required a specification should be provided by the requestor. Network Operations Engineering need to be contracted to determine the operational requirements for schemes including any alarms and additional control required.	
	12. Create new Commissioning sheet	Once the existing configuration is extracted and the scheme requirements are understood a full points list for the works can be created. The commoning of the points is to be updated as per current standards.	Automation Design - Register - Standard Points SCADA SERVICES PEA AND COMMISSIONING SHEET
	13. Create Commissioning plan	A Commissioning plan must be developed for the migration of the points. Typically, the order of cutover is IEDs followed by K and C Cards with S and A modules last.  The commissioning plan should consider <ul style="list-style-type: none"> <li>• Staging of Equipment installation</li> <li>• Impacts on Schemes</li> <li>• Sequence for cutover of points</li> <li>• Temporary commoning of points between RTU and Gateway</li> </ul>	
	14. Request Outage and Master Station Updates	Once points list has been created and commissioning plan is determined an outage can be requested for the RTU. The following inputs are needed to request an outage. <ul style="list-style-type: none"> <li>• SCADA Points Commissioning Sheet</li> <li>• Outage plan and anticipated duration</li> <li>• Impacts on schemes</li> <li>• Confirmation of when construction will be completed</li> <li>• Confirmation of Network Ops and Automation resource availability</li> <li>• Confirmation of when telecommunication services will be implemented</li> </ul>	
	15. Request Head End Configuration Works	The Remote Access and DNP-IP firewall changes need to be requested, the process for these is detailed in configuration Guideline.	Automation Design Guideline Configuration section
	16. Finalise Configuration	The configuration should be completed as per Automation Design - Guideline – Configuration. Standard Logic routines are detailed in	Automation - Equipment Guideline - Gateway Logic Reference
	17. Complete work instructions	Any schemes installed should be detailed in the site work instruction.	SCADA WORK INSTRUCTION -TEMPLATE DOCUMENT
Commissioning Handover	18. Review Construction	Construction works should be reviewed against the design prior to the outage to ensure outstanding works will not impact the outage	
	19. Confirm Resources and External Works	The resources internal to automation and external should be confirmed. Also, at this stage the status of the Head End works, and Telecommunications works should be confirmed.	
	20. Revise Commissioning Plan	Commissioning plan should be reviewed and revised based on the final configuration, any outstanding construction works and resources allocated	
	21. Complete Commissioning	Commissioning, should be completed as per Automation Design - Guideline – Commissioning.	Automation Design Guideline Commissioning section
	22. Finalise External Works	Once cutover is complete then advise Telecommunication of any circuits which are redundant and request final head end changes for decommissioned equipment.  Also arrange for construction to complete any final construction works which may be required.	
	23. Complete Handover	Complete Handover to Maintenance as per Automation Design - Guideline – Commissioning.  A preliminary handover should be sent at the start of commissioning.	
	24. Complete as Built drawings and Update Site Records	Redline drawings and leave a copy of markups on site. Update site configuration records and Site Records in EDM.	

Stage	Task	Overview	References
	25. Complete Review	Review project execution and identify any areas for improvement with processes and templated.	

OPERATIONAL TECHNOLOGY – AUTOMATION DESIGN - eNAR APPLICATION PROCESS

